


LEGEND

WATER AGE (HOUR)

- 0.0 - 20.0
- 20.0 - 50.0
- 50.0 - 120.0
- >120.0

-  EXISTING ELEVATED TANK
-  EXISTING GROUND STORAGE TANK
-  EXISTING STANDPIPE

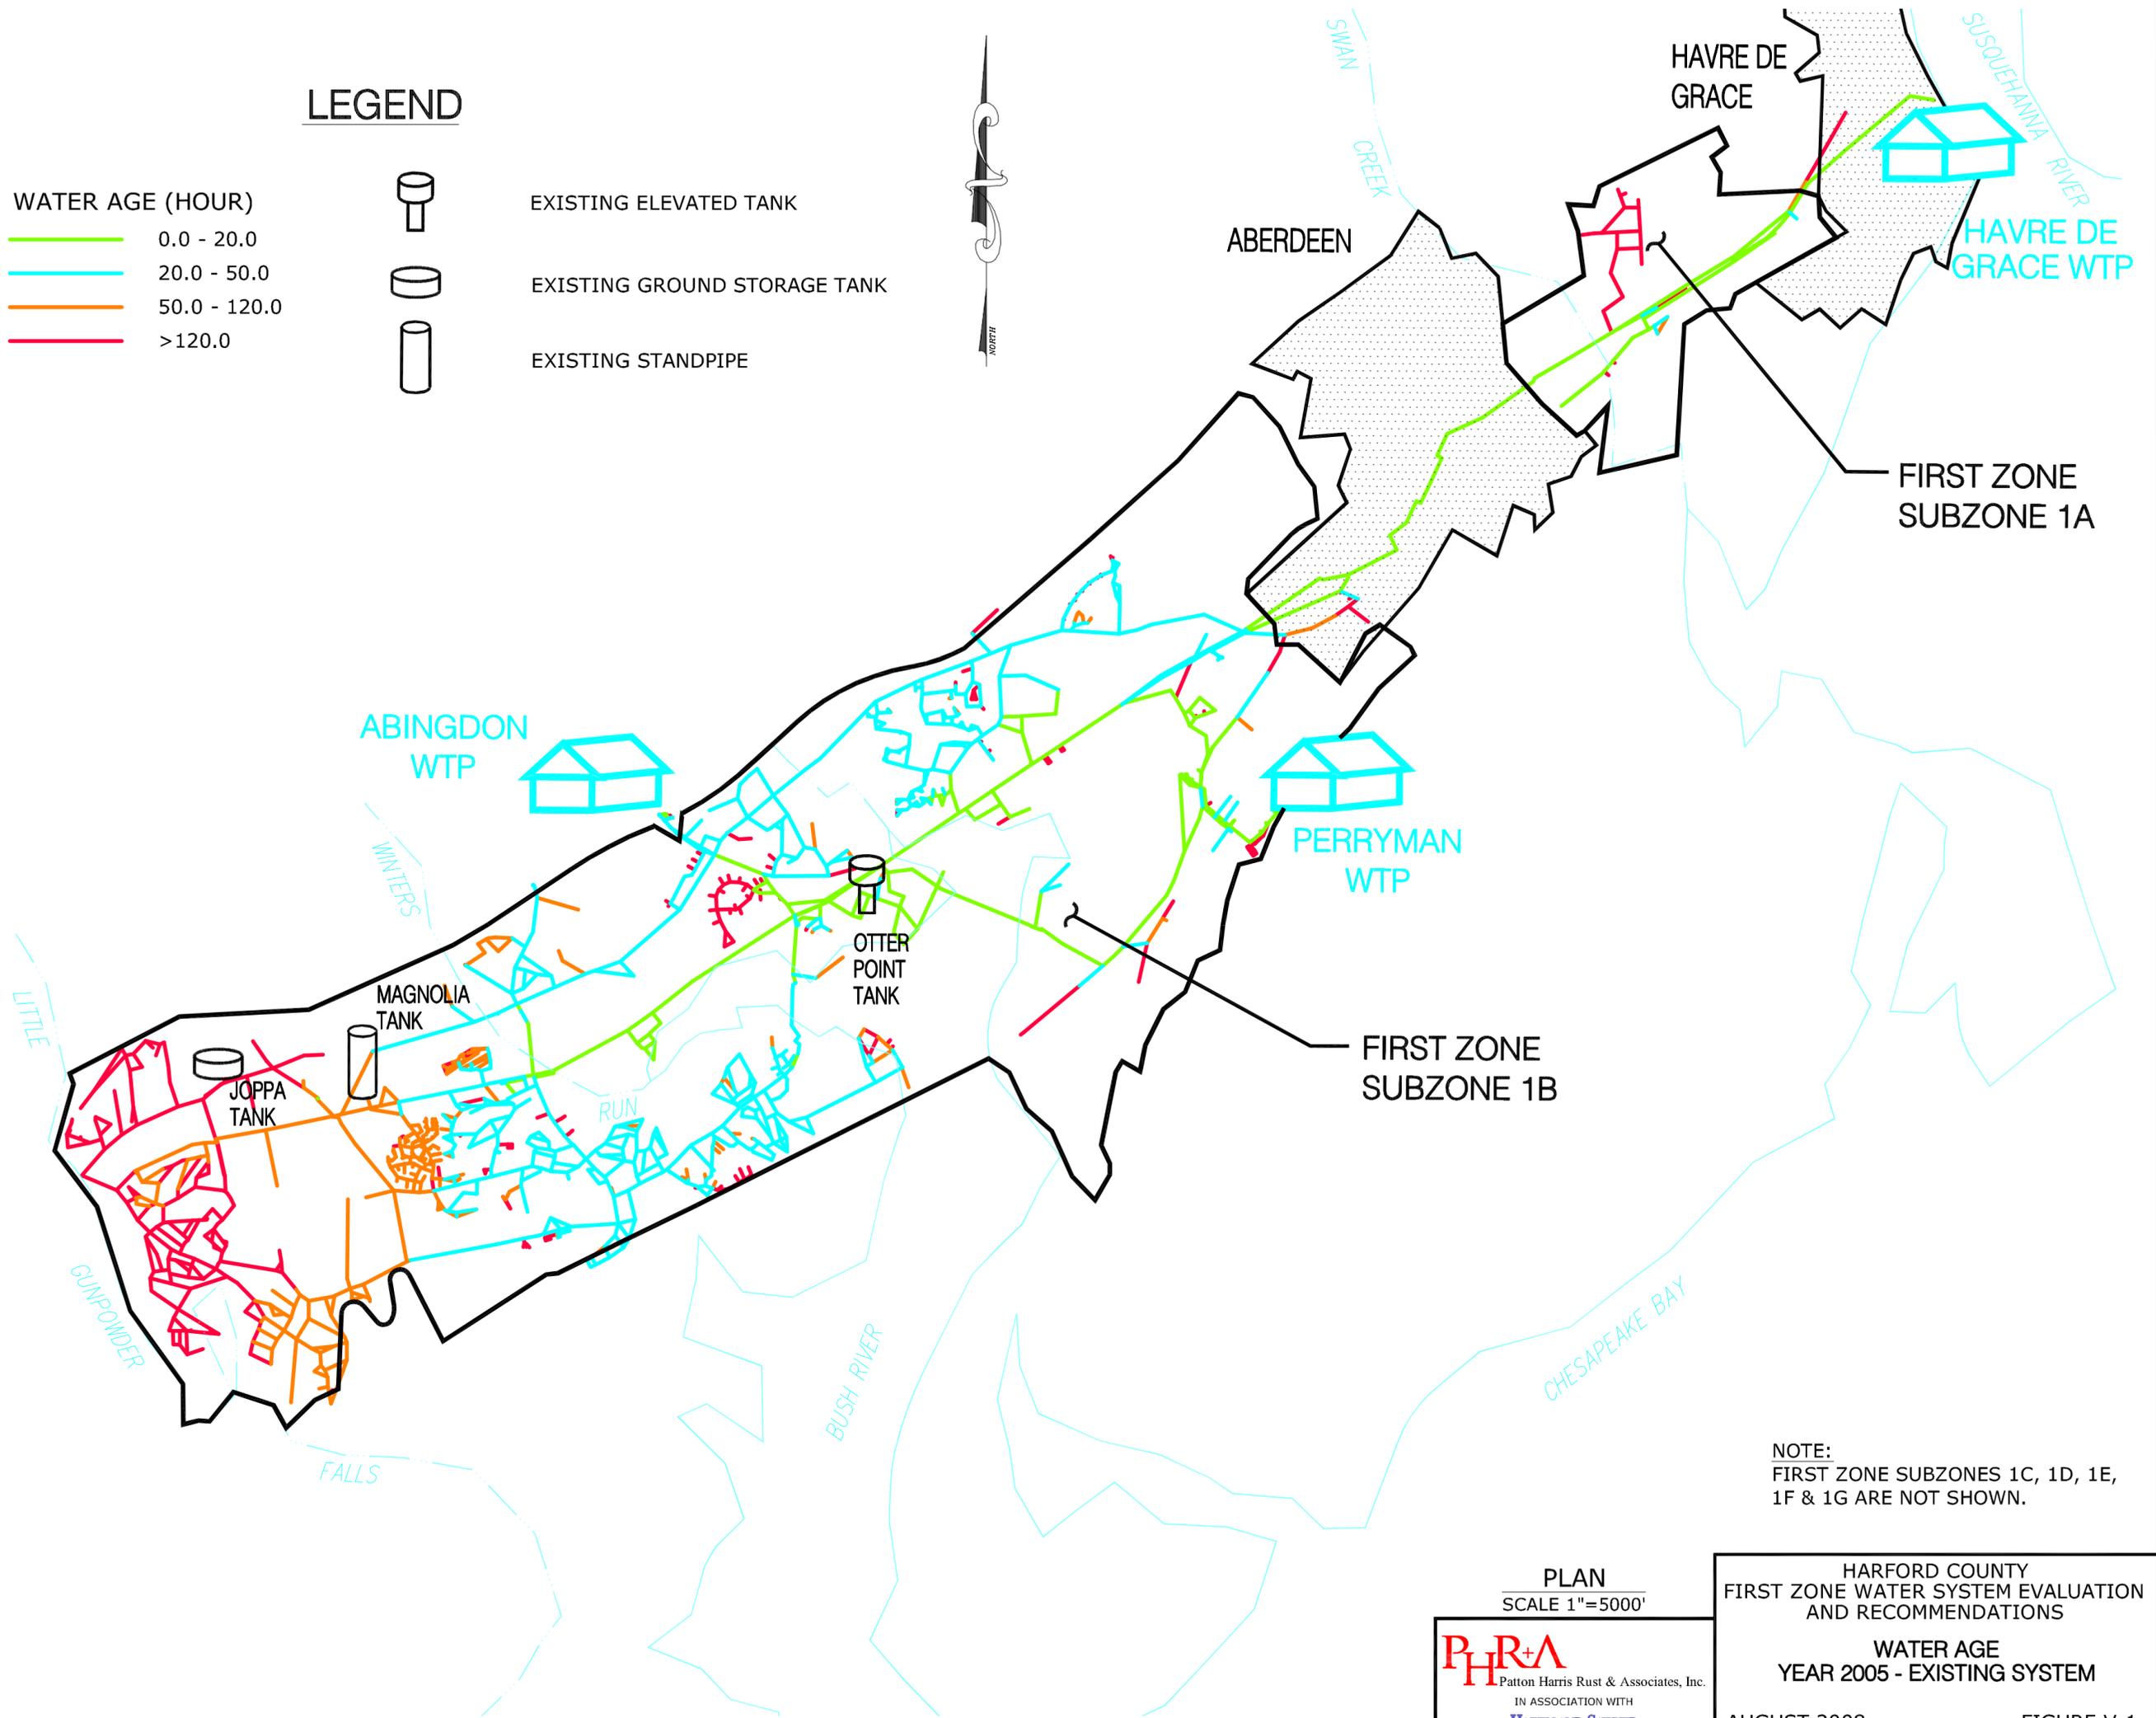

NOTE:
FIRST ZONE SUBZONES 1C, 1D, 1E,
1F & 1G ARE NOT SHOWN.

PLAN
SCALE 1"=5000'



HARFORD COUNTY
FIRST ZONE WATER SYSTEM EVALUATION
AND RECOMMENDATIONS

WATER AGE
YEAR 2005 - EXISTING SYSTEM

AUGUST 2008

FIGURE V-1