

LEGEND

WATER AGE (HOUR)

- 0.0 - 20.0
- 20.0 - 50.0
- 50.0 - 120.0
- >120.0



EXISTING ELEVATED TANK




PROPOSED ELEVATED TANK



EXISTING GROUND STORAGE TANK



EXISTING STANDPIPE

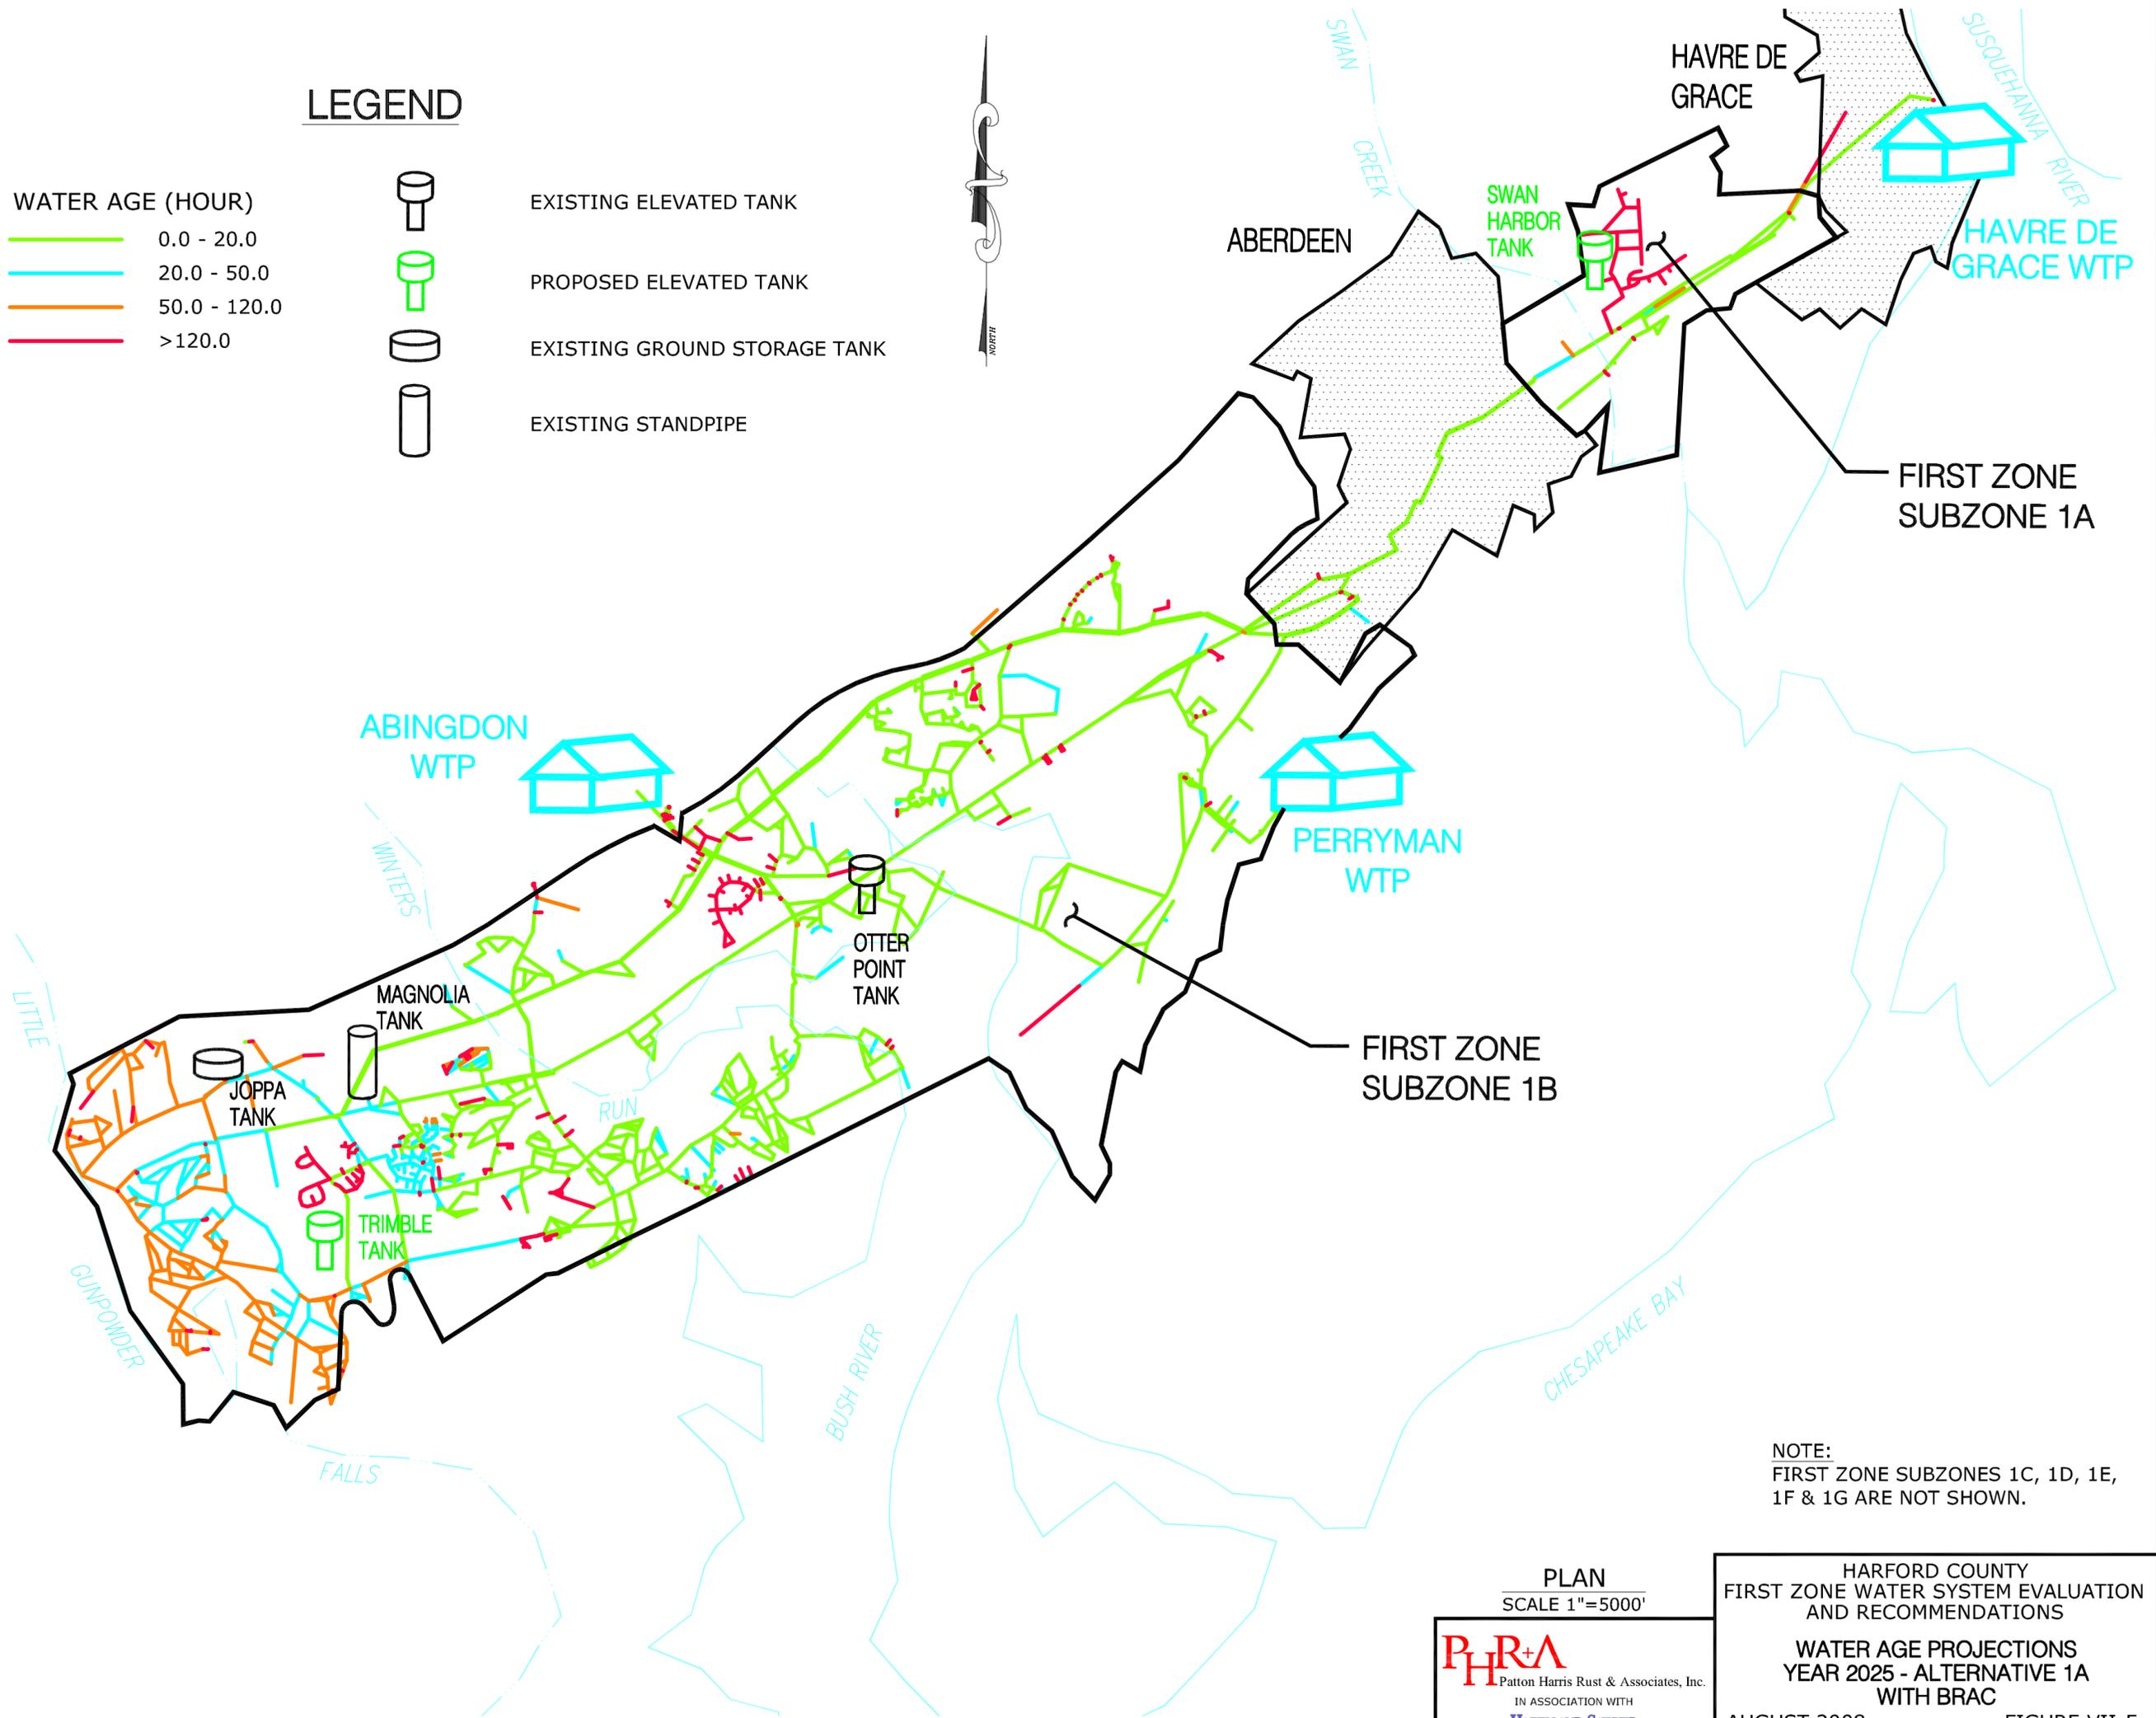

NOTE:
FIRST ZONE SUBZONES 1C, 1D, 1E,
1F & 1G ARE NOT SHOWN.

PLAN
SCALE 1"=5000'



HARFORD COUNTY
FIRST ZONE WATER SYSTEM EVALUATION
AND RECOMMENDATIONS

WATER AGE PROJECTIONS
YEAR 2025 - ALTERNATIVE 1A
WITH BRAC

AUGUST 2008

FIGURE VII-5