


LEGEND

WATER AGE (HOUR)

- 0.0 - 20.0
- 20.0 - 50.0
- 50.0 - 120.0
- >120.0



EXISTING ELEVATED TANK
 PROPOSED ELEVATED TANK
 EXISTING GROUND STORAGE TANK
 EXISTING STANDPIPE

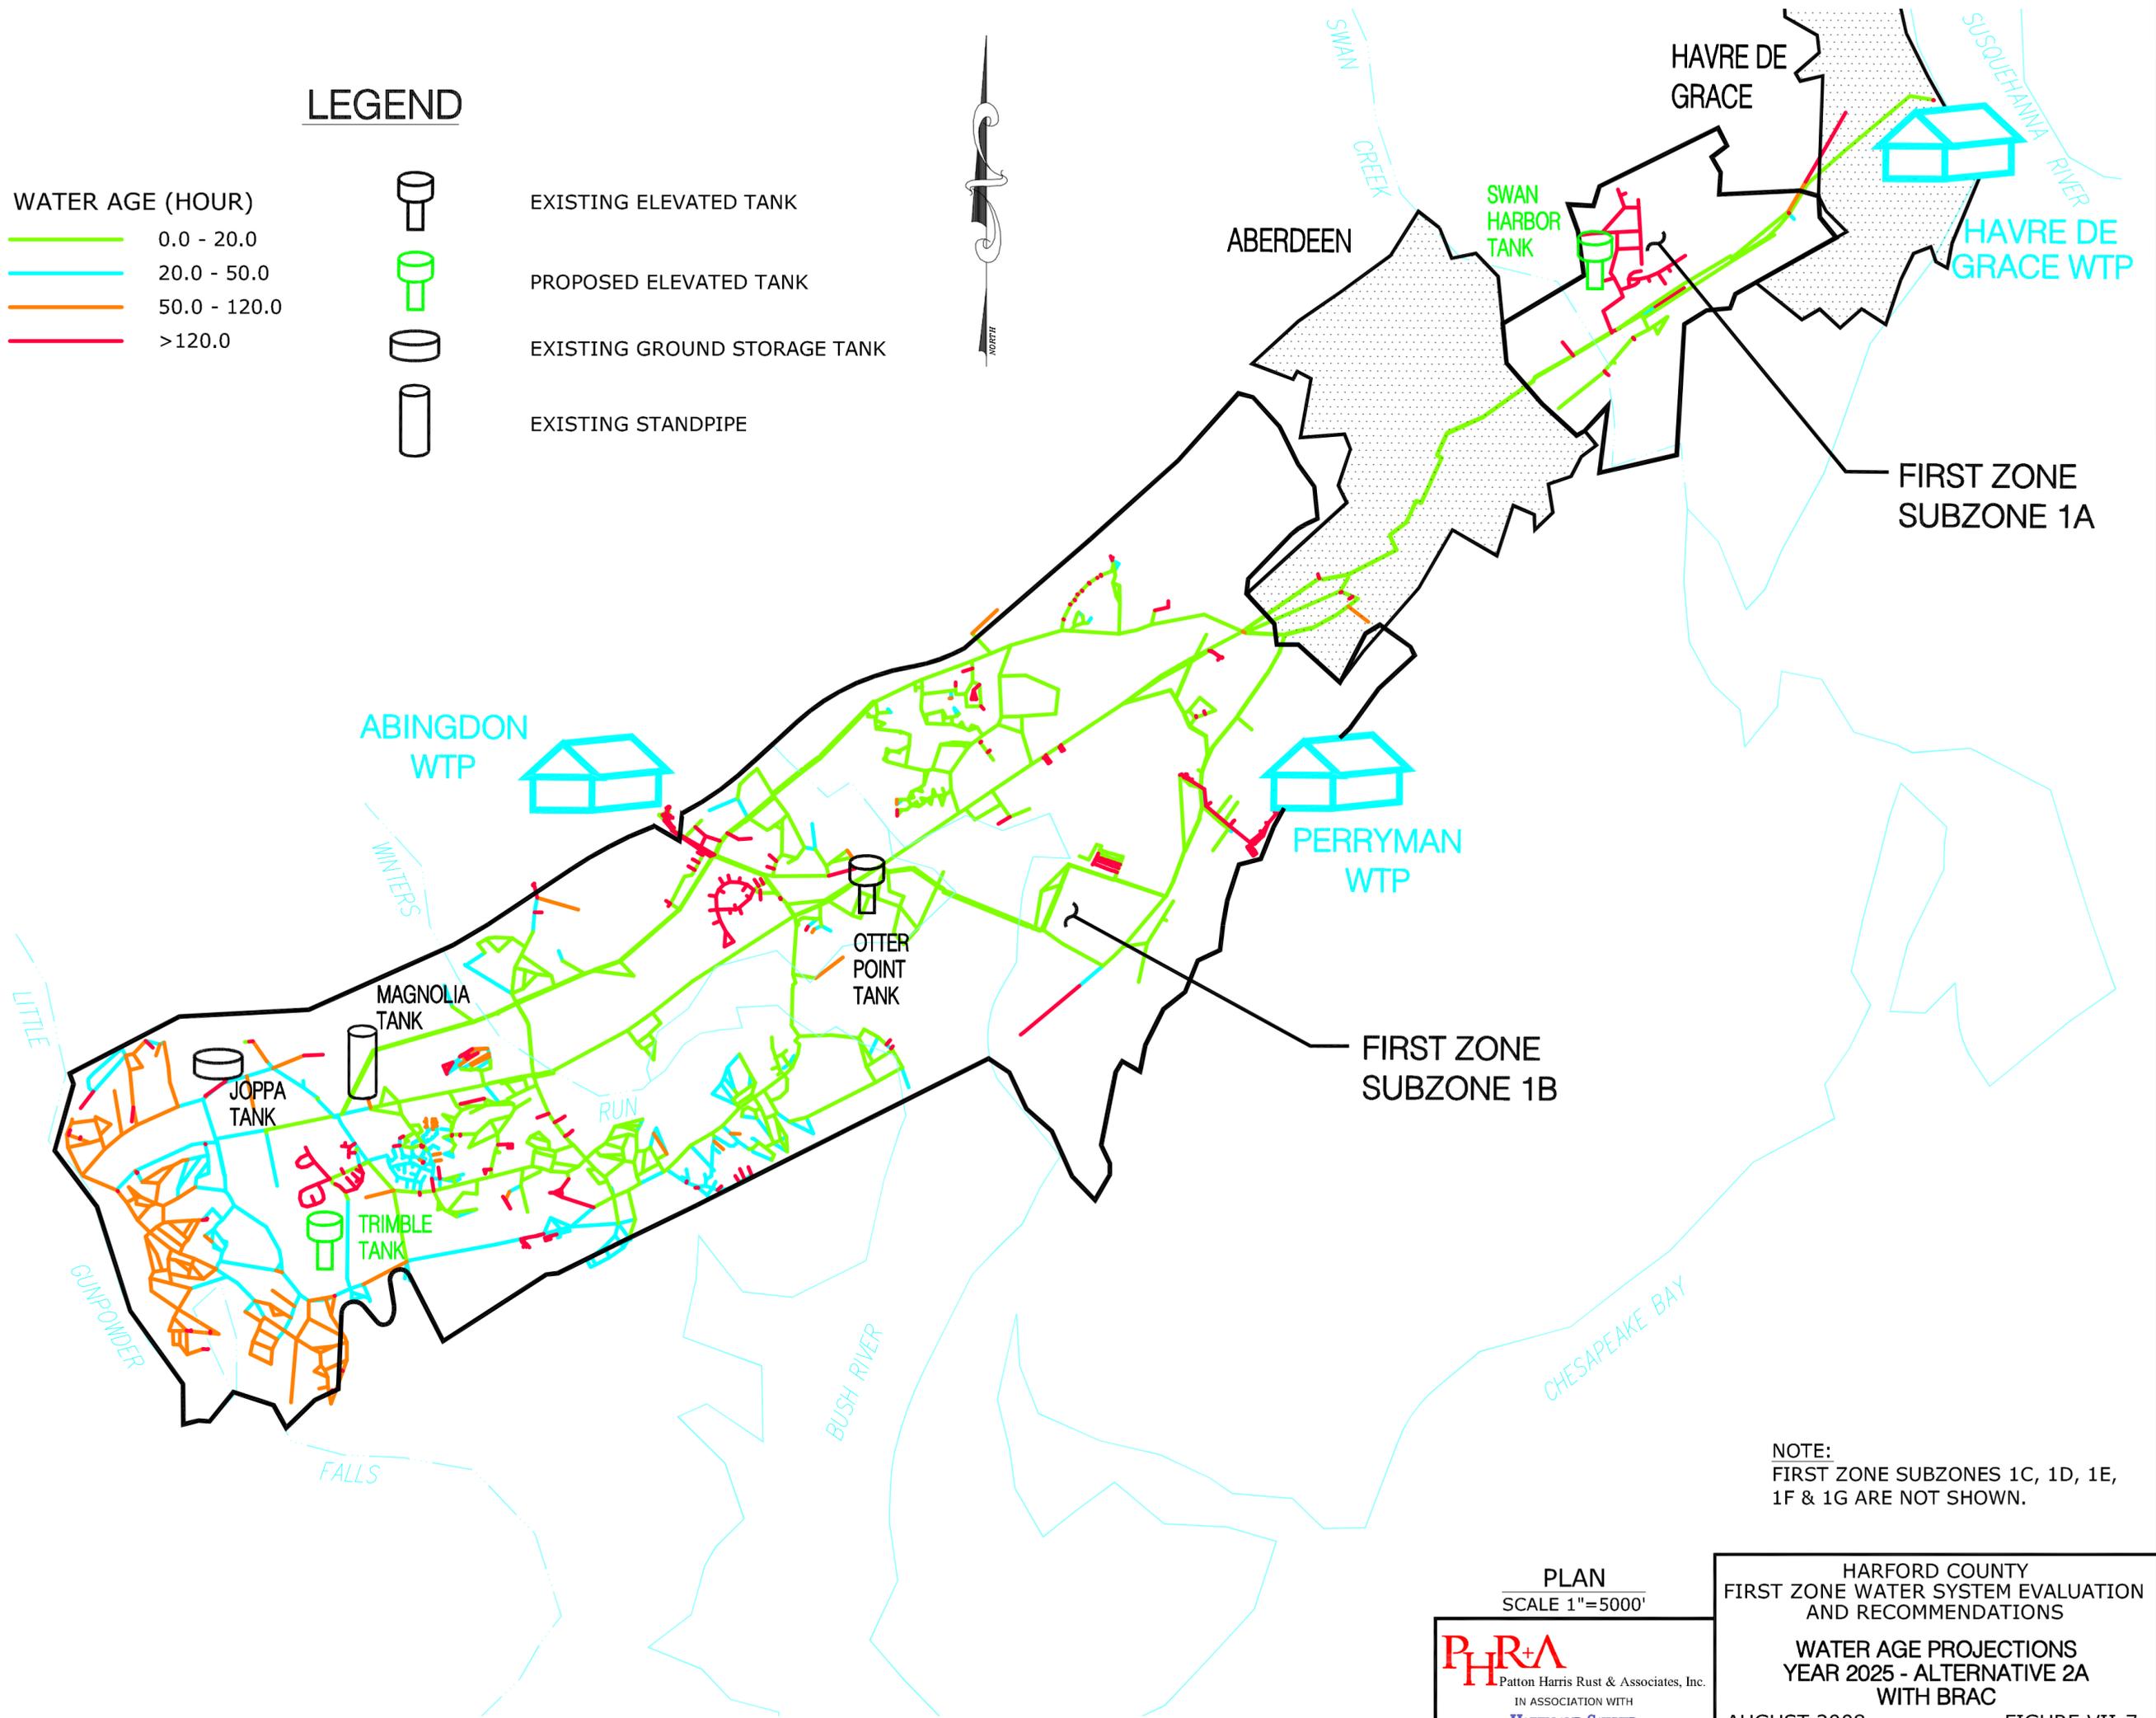

NOTE:
 FIRST ZONE SUBZONES 1C, 1D, 1E,
 1F & 1G ARE NOT SHOWN.

PLAN
 SCALE 1"=5000'



HARFORD COUNTY
 FIRST ZONE WATER SYSTEM EVALUATION
 AND RECOMMENDATIONS
 WATER AGE PROJECTIONS
 YEAR 2025 - ALTERNATIVE 2A
 WITH BRAC
 AUGUST 2008
 FIGURE VII-7