


LEGEND

WATER AGE (HOUR)
 0.0 - 20.0
 20.0 - 50.0
 50.0 - 120.0
 >120.0

-  EXISTING ELEVATED TANK
-  PROPOSED ELEVATED TANK
-  EXISTING GROUND STORAGE TANK
-  EXISTING STANDPIPE

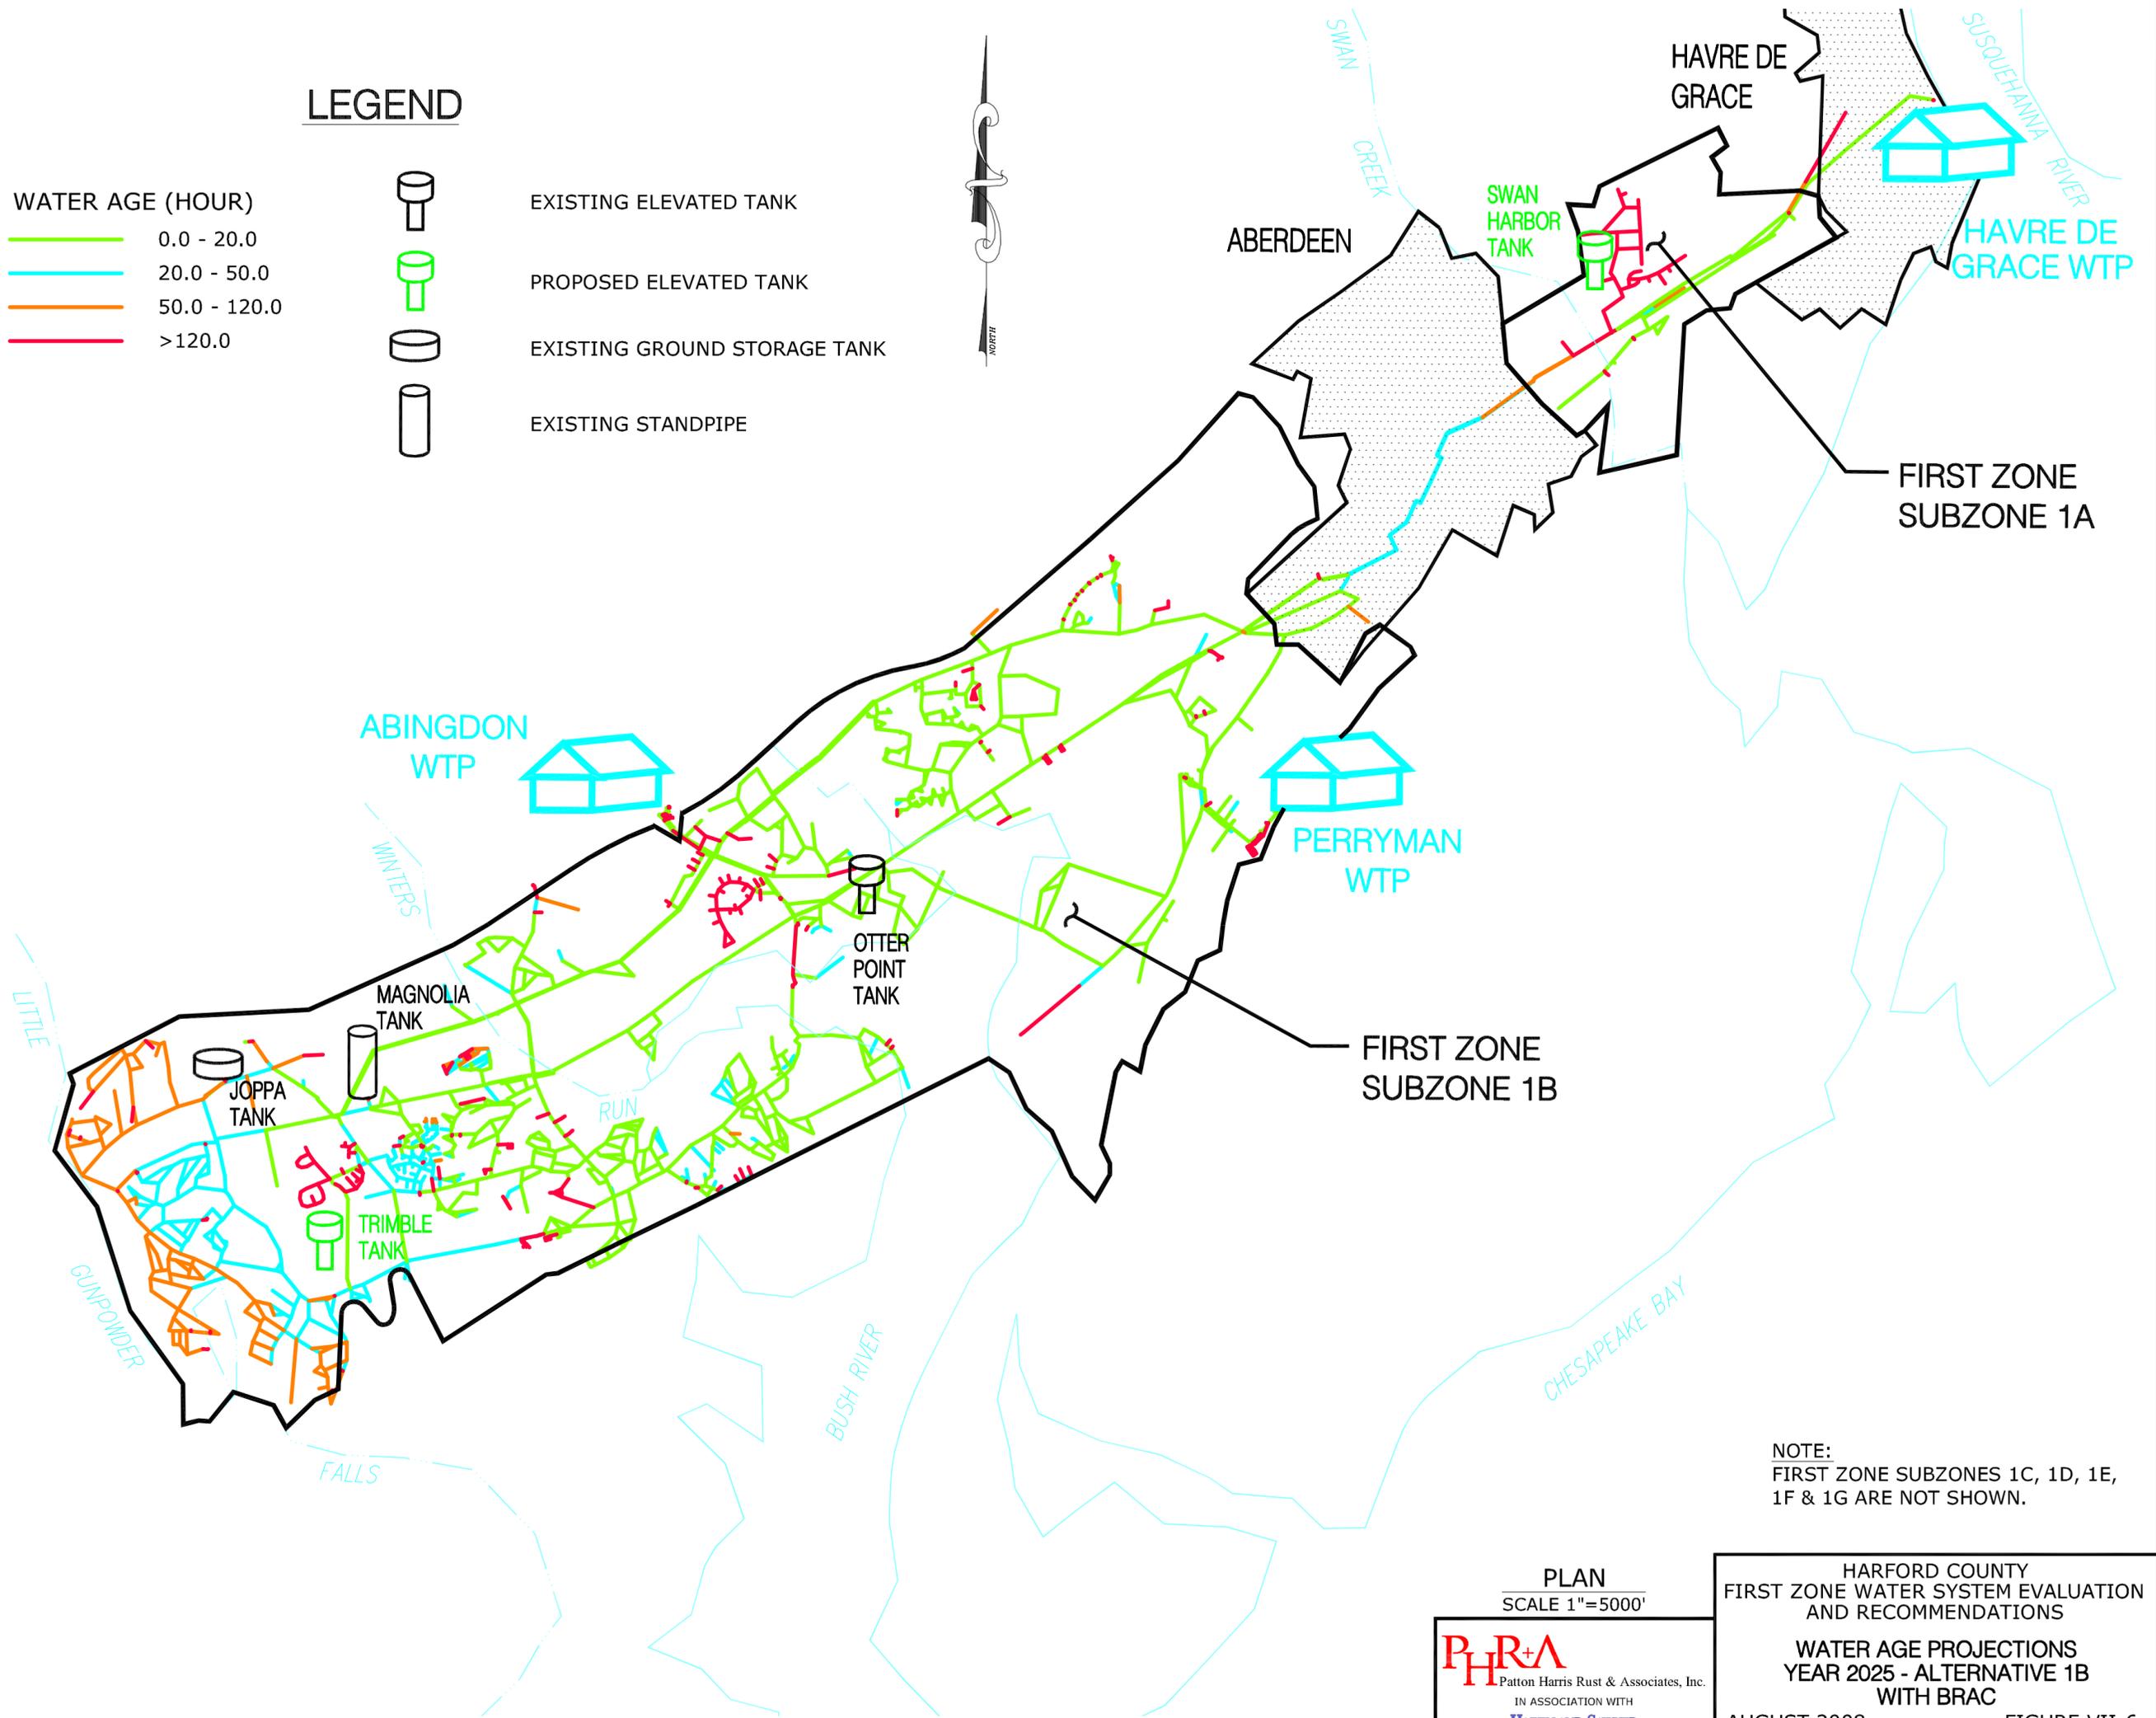

NOTE:
 FIRST ZONE SUBZONES 1C, 1D, 1E,
 1F & 1G ARE NOT SHOWN.

PLAN
 SCALE 1"=5000'

P+H+R+A
 Patton Harris Rust & Associates, Inc.
 IN ASSOCIATION WITH
HAZEN AND SAWYER

HARFORD COUNTY
 FIRST ZONE WATER SYSTEM EVALUATION
 AND RECOMMENDATIONS

WATER AGE PROJECTIONS
 YEAR 2025 - ALTERNATIVE 1B
 WITH BRAC

AUGUST 2008

FIGURE VII-6