


LEGEND

RESIDUAL CHLORINE
(MG / L)

- >1.2
- 0.5 - 1.2
- 0.2 - 0.5
- 0.0 - 0.2



- EXISTING ELEVATED TANK
- PROPOSED ELEVATED TANK
- EXISTING GROUND STORAGE TANK
- EXISTING STANDPIPE

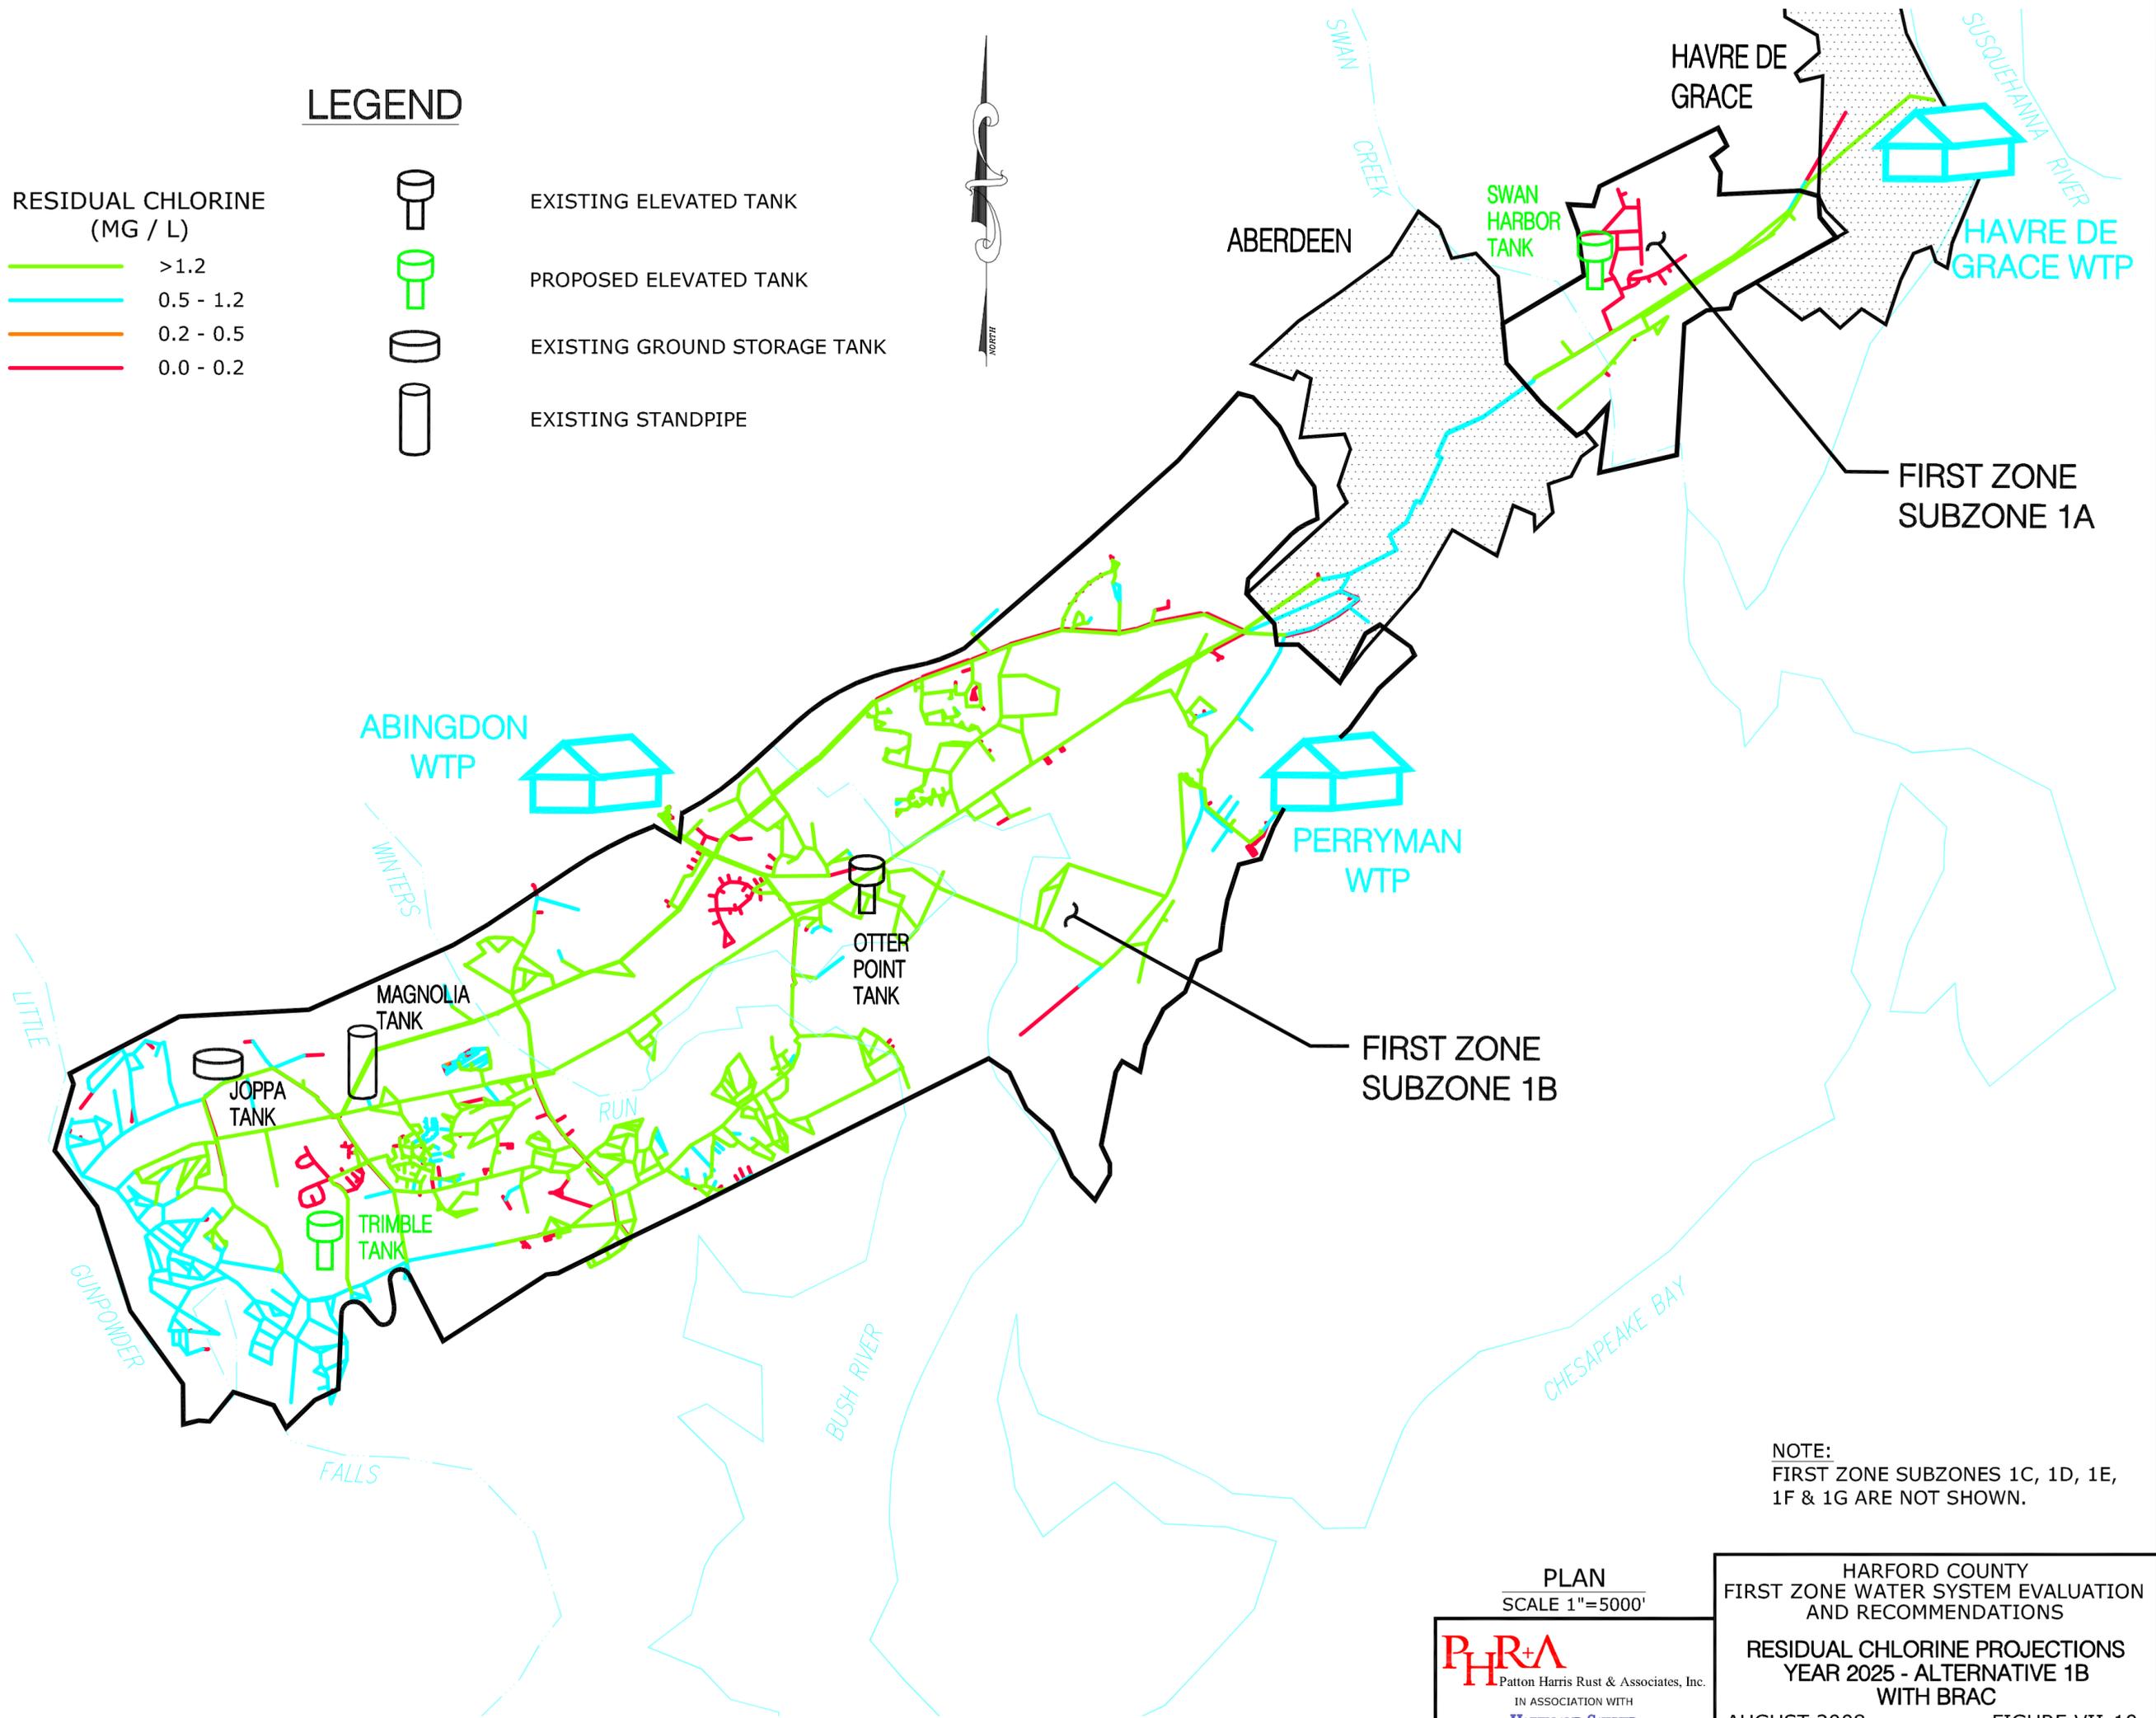

NOTE:
FIRST ZONE SUBZONES 1C, 1D, 1E,
1F & 1G ARE NOT SHOWN.

PLAN
SCALE 1"=5000'

P+H+R+A
Patton Harris Rust & Associates, Inc.
IN ASSOCIATION WITH
Hazen and Sawyer

HARFORD COUNTY
FIRST ZONE WATER SYSTEM EVALUATION
AND RECOMMENDATIONS

RESIDUAL CHLORINE PROJECTIONS
YEAR 2025 - ALTERNATIVE 1B
WITH BRAC

AUGUST 2008

FIGURE VII-10